



ENVIRONMENT, SAFETY & HEALTH DIVISION

# Seismic Design Specification for Buildings, Structures, Equipment, and Systems: 2011

SLAC-I-720-0A24E-001-R003  
3 October 2011

# Publication Data

This document was developed by the Seismic Design program and published by ESH Publishing.

Document Title: Seismic Design Specification for Buildings, Structures, Equipment, and Systems: 2011

Original Publication Date: 4 August 1999

Revision Date: 3 October 2011

Effective Date: 3 October 2011

Department: Environment, Safety & Health Division

Document Number: SLAC-I-720-0A24E-001-R003

ProductID: [59](#) | RevisionID: [1326](#)

URL: <http://www-group.slac.stanford.edu/esh/documents/techbas/seismic.pdf>

Prepared for the United States Department of Energy under contract DE-AC02-76-SFO0515

*Note*    *The technical content of this revision was authored by SLAC civil and structural engineers: Kenneth Yang, SE, Facilities Division; Lori Plummer, PE, Accelerator Directorate; and Michael Loomis, SE, consultant to Building Inspection Office, ESH Division. The content was also reviewed by Scott DeBarger, chair, Earthquake Safety Committee; Javier Sevilla, PE, ECPM manager, Facilities Division; and Ernie Gomes, manager, Building Inspection Office, ESH Division.*

# Executive Summary

This document is intended to provide an overview of the requirements for seismic analysis and design of buildings, structures, equipment and systems that will be constructed and installed at SLAC National Accelerator Laboratory.

SLAC will use the 2010 *California Building Code (CBC)* for structural design criteria. These criteria, as written, will provide a level of seismic performance equal to or higher than that currently used at SLAC.



# Contents

Publication Data

Executive Summary

Contents	i
1 General Design Requirements	1
1.1 Design Guidance	1
1.2 Modular / Portable Buildings	2
1.3 Nonstructural Components	2
2 Programmatic / Experimental Equipment Design Requirements	3
3 Approved Concrete Anchors	3
4 Special Design Requirements	4
4.1 Determination and Approval	4
5 Seismic Design Map	5



# 1 General Design Requirements

SLAC will use the 2010 *California Building Code (CBC)* for structural design criteria.<sup>1</sup> These criteria, as written, will provide a level of seismic performance equal to or higher than that currently used at SLAC.

The 2010 CBC adjusts the level of design based on occupancy categories from level I to level IV. Most projects at SLAC will be Occupancy Category II, which provides life safety seismic performance. There are a few exceptions to this occupancy category that are clearly identified in the building code. These exceptions include assembly occupancies where more than 300 people congregate (Occupancy Category III) and essential facilities such as the fire station and emergency operations centers (Occupancy Category IV) requiring continued operation during and/or after an earthquake.

## 1.1 Design Guidance

In order to facilitate the process of designing structures and equipment anchorage, the following issues should be considered when designing for resistance to seismic loads:

- Site-specific seismic criteria may be based on values determined in accordance with ASCE 7-2005<sup>2</sup> as amended by the 2010 CBC, Chapter 16. As an alternative, the seismic criteria may be based on the worst case values shown in Section 5 of this document for the location of the proposed work.
- For all anchors embedded into concrete that resist seismic loading, the cracked concrete provisions of ACI 318-2008<sup>3</sup>, Appendix D, as amended by 2010 CBC, Sections 1908.1.9 and 1912.1, must be considered.
  - Post-installed anchors installed into hardened concrete (such as epoxy or expansion anchors) must be designed and installed in accordance with the same cracked concrete provisions using the procedures summarized by the manufacturer’s approved ICC-ES report.<sup>4</sup> Additional information on post-installed anchors can be found in Section 4 of this document.

---

1 Title 24, *California Code of Regulations*, “California Building Standards Code”, Part 2, “California Building Code” ([24 CCR Part 2](#))

A hard copy is available; see <http://www.slac.stanford.edu/spires/find/books/www?key=383376>.

2 American Society of Civil Engineers (ASCE) 7-2005, “Minimum Design Loads for Buildings and Other Structures, including Supplements No. 1 and 2” ([ASCE 7-2005](#))

For a list of ASCE standards and errata, see the ASCE Structural Engineering Institute, <http://content.seinstitute.org/>.

3 American Concrete Institute (ACI) 318-2008, “Building Code Requirements for Structural Concrete and Commentary” ([ACI 318-2008](#))

For a list of ACI standards, see the ACI Bookstore, <http://www.concrete.org/bookstorenet/default.aspx>.

4 International Code Council (ICC) Evaluation Report (ER)

For a list of ICC ERs, see “ICC-ES: Evaluation Reports”, [http://www.icc-es.org/Evaluation\\_Reports/index.shtml](http://www.icc-es.org/Evaluation_Reports/index.shtml)

- There are a number of safety factors for anchors installed in concrete. The 0.75 safety factor from ACI 318-2008, Section D.3.3.3 (used to adjust  $\phi N_n$  and  $\phi V_n$ ) is applicable in all cases at the SLAC site.
- Anchor design must be governed by ductile yielding of a steel element (anchor or attachment), unless the exceptions of 2010 CBC, Section 1908.1.9 are met. See ACI 318-08, Section D.3.3.4, D.3.3.5, and D.3.3.6 for design requirements.
- Any questions about correct implementation of code requirements for seismic design should be directed to the Building Inspection Office (BIO) or structural authority having jurisdiction (AHJ).

## 1.2 Modular / Portable Buildings

Modular/portable buildings that are permanently installed must be designed to meet the same criteria as those installed at California public schools K-12 and anchored to meet the criteria for Occupancy Category II.

## 1.3 Nonstructural Components

In compliance with the 2010 CBC, nonstructural components (including architectural, mechanical, electrical, and plumbing equipment) and their supports and attachments that are permanently attached to a structure must be designed and constructed to resist the effects of the earthquake motions in accordance with the code. Refer to ASCE 7-2005, Chapter 13, for specific requirements.

ASCE 7-2005 exemptions that apply at SLAC are the following. Note that these exemptions do not require a designed anchorage, but all equipment still must be secured in place as directed by code:

- Mechanical and electrical components with Importance Factor,  $I_p$ , equal to 1.0 and both of the following conditions apply:
  - Flexible connections between the components and associated ductwork, piping, and conduit are provided.
  - Components are mounted at four feet or less above a floor level and weigh 400 pounds or less.
- Mechanical and electrical components with Importance Factor,  $I_p$ , equal to 1.0 and both of the following conditions apply:
  - Flexible connections between the components and associated ductwork, piping, and conduit are provided.
  - And the components weigh 20 pounds or less or, for distribution systems, weighing five pounds per foot or less.

## 2 Programmatic / Experimental Equipment Design Requirements

The following programmatic/experimental equipment and structures must be designed and constructed to resist the effects of earthquake motions in a manner that ensures life safety:

- Any structure that personnel can enter, such as radiation hatches and shielding structures.  
The seismic design criteria will be met by using the 2010 CBC for seismic design (Occupancy Category as appropriate per the 2010 CBC).
- Any experimental equipment that weighs more than 400 pounds.  
The seismic design criteria will be met by using the 2010 CBC for seismic design (Occupancy Category II). For ground-mounted experimental equipment, the alternate method given below may be used with the following Strength Design load combinations:
  - $(1.5) \times \text{Dead Load} + E$
  - $(0.6) \times \text{Dead Load} + E$

Where “Dead Load” includes operating live load (where applicable) and “E” = effects of horizontal seismic forces. The seismic loading is analyzed as an inertial force, so the effects of the horizontal acceleration may include overturning.

**Table 1** Horizontal Earthquake Acceleration Values for Experimental Equipment

Horizontal Earthquake Acceleration	Experimental Equipment Structure Type Similar to the Following
0.7 g	<ul style="list-style-type: none"> <li>▪ Elevated tanks, vessels, bins, or hoppers on symmetrically braced legs</li> <li>▪ Horizontal, saddle supported welded steel vessels</li> <li>▪ Flat-bottom ground-supported tanks (steel or fiber reinforced plastic)</li> <li>▪ Steel and reinforced concrete distributed mass cantilever structures</li> <li>▪ Components and systems isolated using neoprene elements</li> </ul>
0.85 g	<ul style="list-style-type: none"> <li>▪ Elevated tanks, vessels, bins, or hoppers on unbraced or asymmetrically braced legs</li> <li>▪ Inverted pendulum type structure (except elevated tanks, vessels, bins or hoppers)</li> <li>▪ Spring isolated components and systems</li> </ul>

In all cases, the anchors and the adequacy of the anchorage to support the design loads must be design-reviewed by a California-licensed civil engineer.

## 3 Approved Concrete Anchors

Post-installed anchors (anchors installed into existing hardened concrete) must be approved to resist seismic loads and have a current ICC-ES report. Where anchorage conditions require an engineered design,

it must be performed in accordance with the ICC-ES report and the cracked concrete provisions of ACI 318-2008, Appendix D.

Some commonly used, approved anchors are listed below (intended as examples, not an all inclusive list):

- Epoxy anchors: Hilti HIT-RE 500SD (ICC ESR No. 2322)  
Simpson SET-XP (ICC ESR No. 2508)
- Expansion anchors: Hilti Kwik-Bolt TZ (ICC ESR No. 1917)  
Simpson Strong-Bolt (ICC ERS No. 1771)

## 4 Special Design Requirements

There is the possibility that a project at SLAC will require exceptional seismic performance (higher than would be required per the building code), due to special importance to mission or extreme safety hazard.

For these projects, the structural design must use the importance factors for Occupancy Category IV. Only the importance factor is changed; the building code chapters used for structural design would be those that are normally used for the particular structure.

The imposition of Occupancy Category IV has a significant design and cost impact, requiring seismic testing for the internal parts of equipment such as electrical panel boards, HVAC units, and racks, in addition to stringent building structural requirements. This category is intended to apply only to those structures and systems that must be fully operable during and immediately after a design-level earthquake.

### 4.1 Determination and Approval

The decision to identify a project as being critical to safety or mission and assign it to Occupancy Category IV requires the written approval of the laboratory director. This determination must be made and properly documented, during the initiating and conceptual phase of the project, using the policy and guidelines from DOE G 420.1-2.<sup>5</sup>

---

5 Department of Energy Guide 420.1-2, "Guide for the Mitigation of Natural Phenomena Hazards for DOE Nuclear Facilities and Non-Nuclear Facilities" ([DOE G 420.1-2](#))

## 5 Seismic Design Map

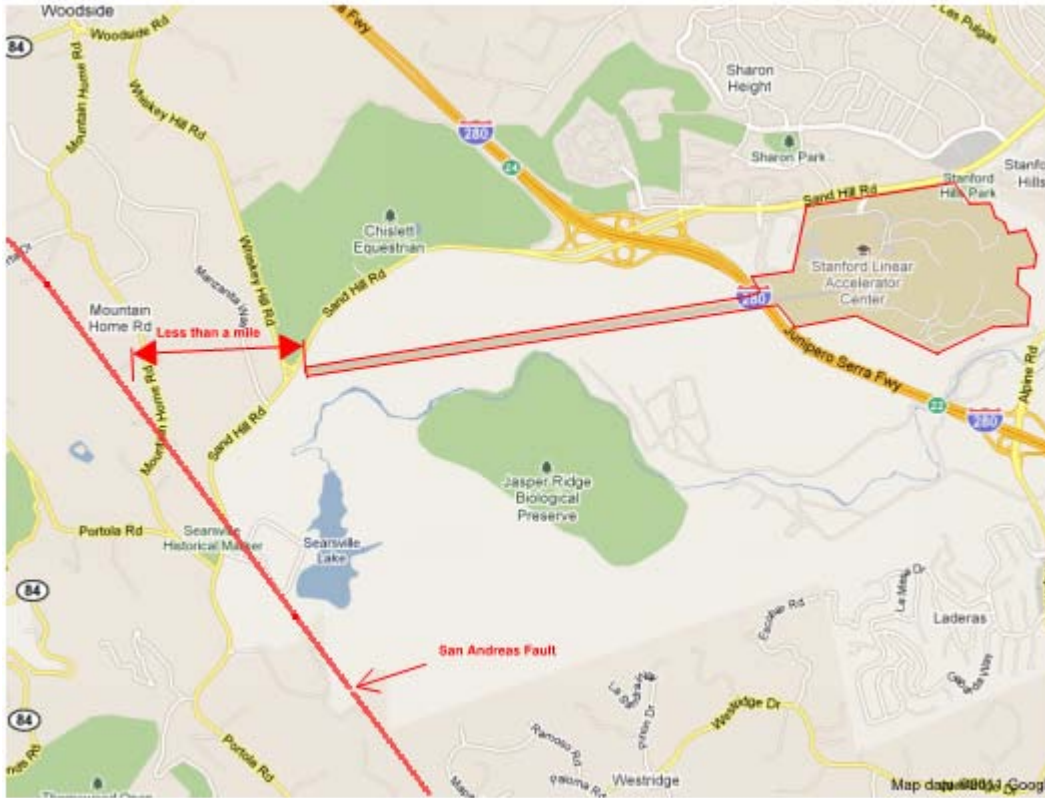


Figure 1 Proximity to San Andreas Fault

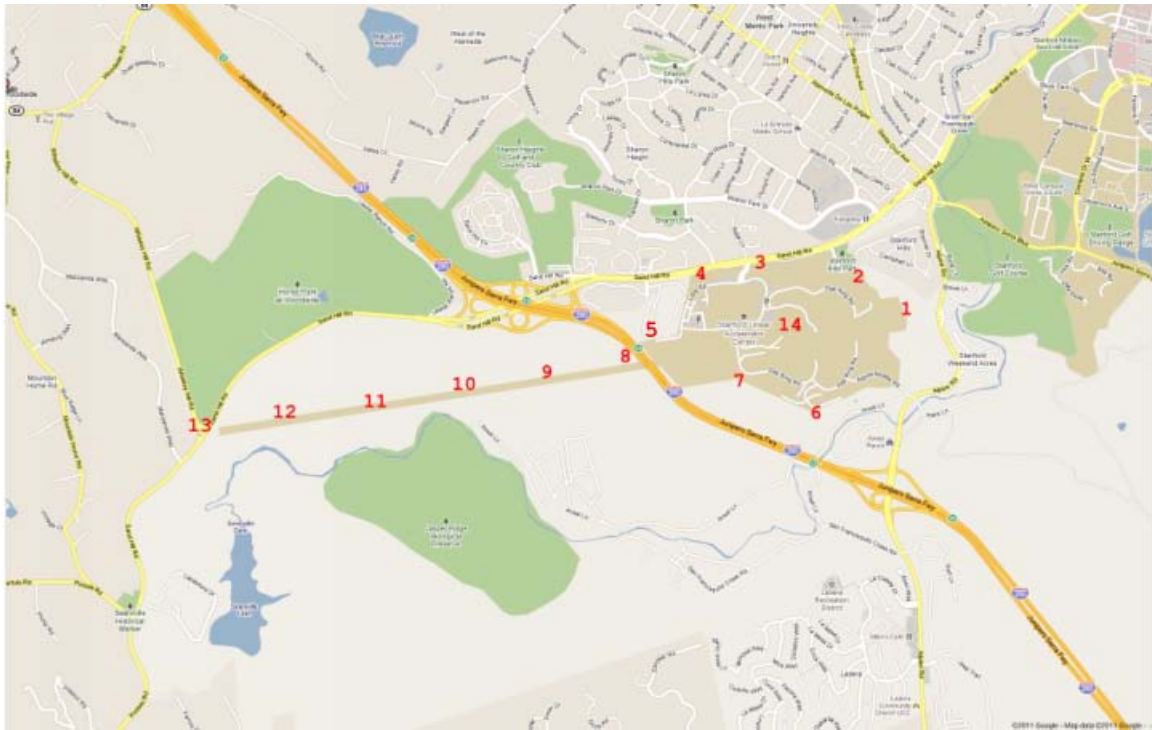


Figure 2 SLAC Map

Table 2 Seismic Ground Motion Values

Location	$S_s$	$S_1$	$S_{DS}$	$S_{D1}$	SDC O.C. I/II	SDC O.C. III	SDC O.C. IV
1	2.343	0.956	1.562	0.956	E	E	F
2	2.354	0.966	1.570	0.966	E	E	F
3	2.405	0.995	1.603	0.995	E	E	F
4	2.456	1.024	1.637	1.024	E	E	F
5	2.487	1.047	1.659	1.047	E	E	F
6	2.445	1.011	1.630	1.011	E	E	F
7	2.462	1.028	1.641	1.028	E	E	F
8	2.502	1.065	1.668	1.065	E	E	F
9	2.518	1.132	1.679	1.132	E	E	F
10	2.518	1.132	1.679	1.132	E	E	F
11	2.518	1.181	1.679	1.181	E	E	F
12	2.518	1.234	1.679	1.234	E	E	F
13	2.518	1.239	1.679	1.239	E	E	F
14	2.428	1.006	1.619	1.006	E	E	F

\*The SDS values are based on site class D