


Measurements

Sp1	66.6 °C
Sp2	47.9 °C
Sp3	66.4 °C
Sp4	69.5 °C
Sp5	20.4 °C
Sp6	30.5 °C
Sp7	31.6 °C

Parameters

Emissivity	0.95
Refl. temp.	20 °C

4/2/2021 2:08:32 PM

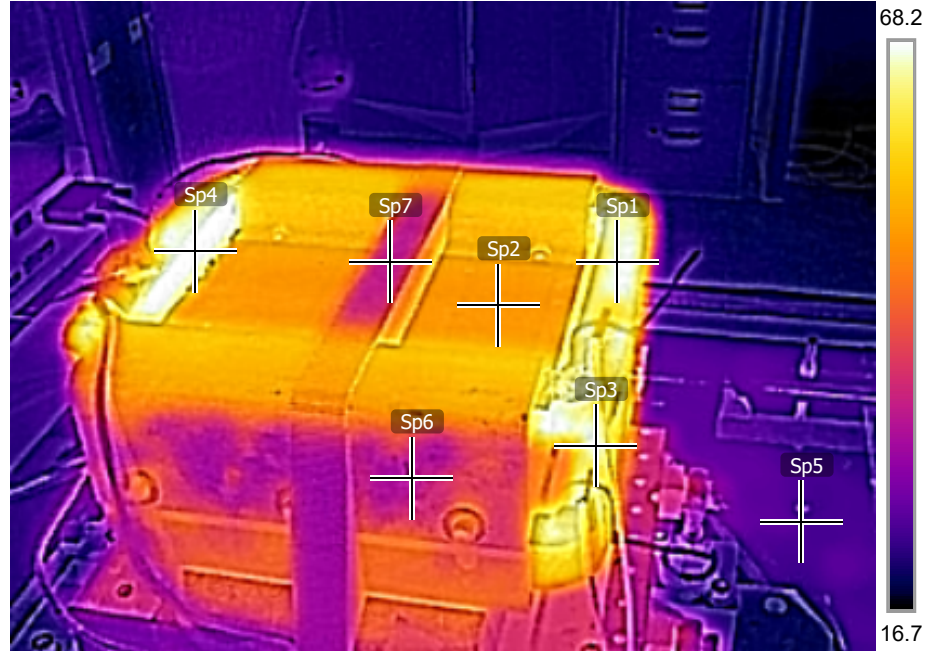


FLIR0025.jpg

FLIR C3

720149250

4/2/2021 2:08:32 PM

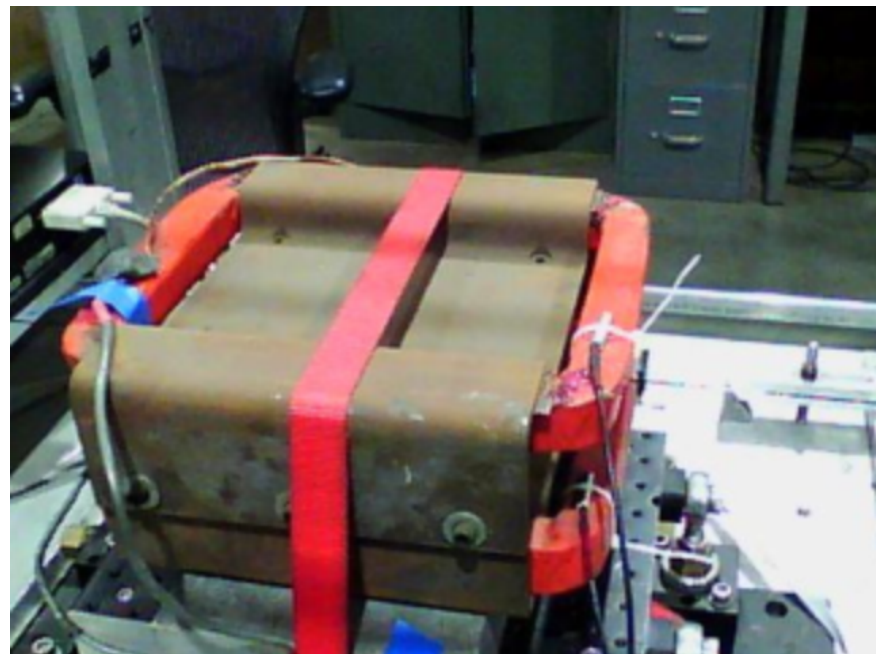

FLIR0025.jpg

FLIR C3

720149250


Measurements

Sp1	54.4 °C
Sp2	67.0 °C


Parameters

Emissivity	0.95
Refl. temp.	20 °C

4/2/2021 2:08:40 PM

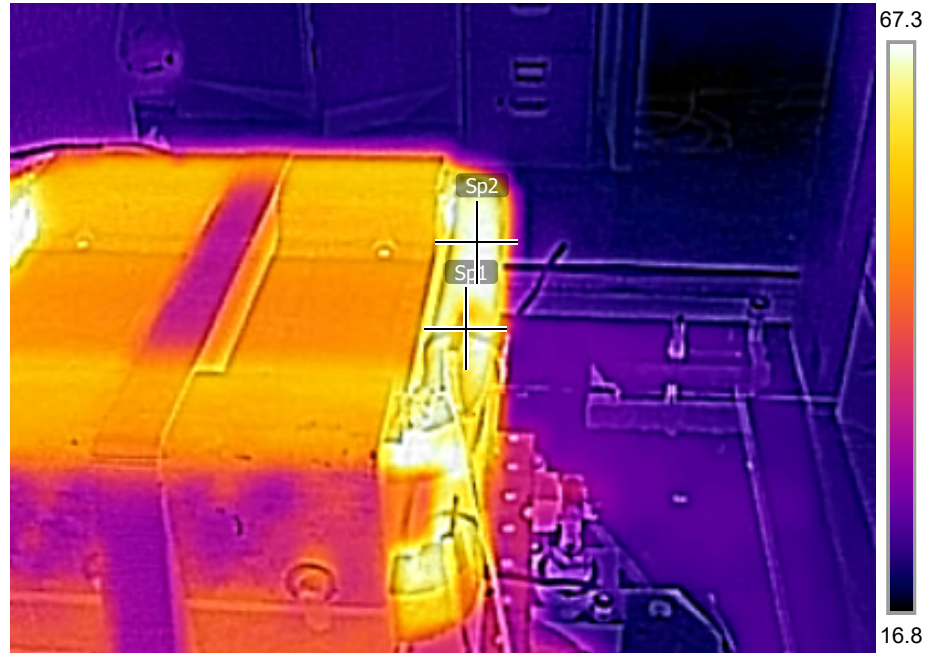

4/2/2021 2:08:40 PM

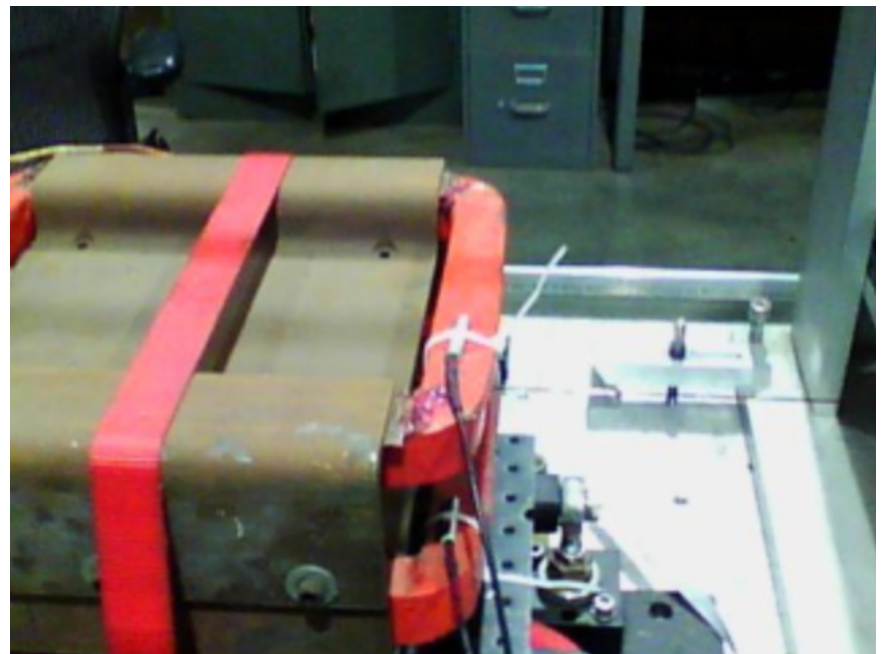


Measurements

Sp1	43.9 °C
Sp2	67.3 °C

Parameters

Emissivity	0.95
Refl. temp.	20 °C

4/2/2021 2:08:49 PM

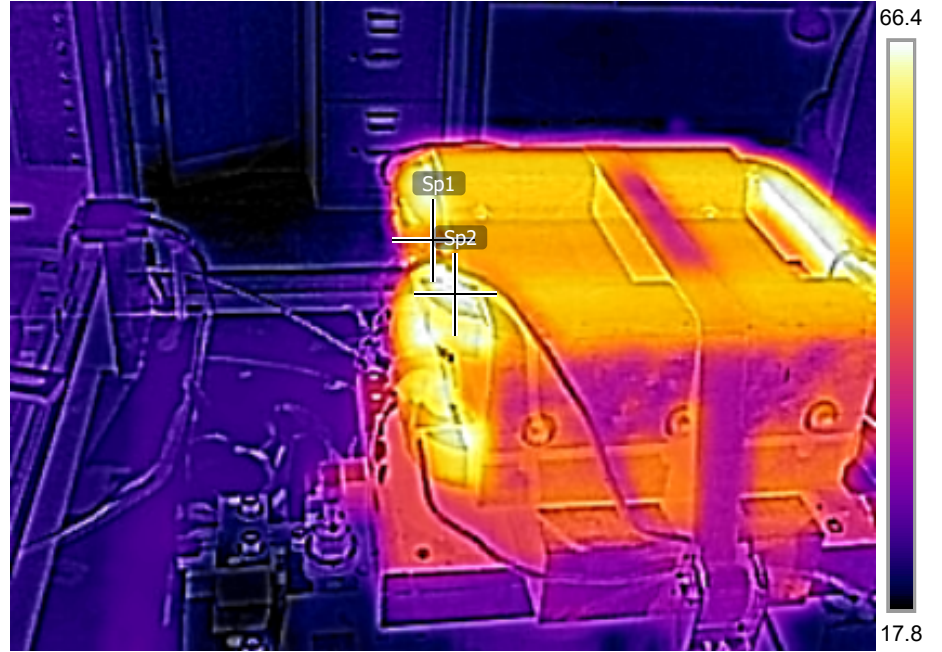


FLIR0027.jpg

FLIR C3

720149250

4/2/2021 2:08:49 PM

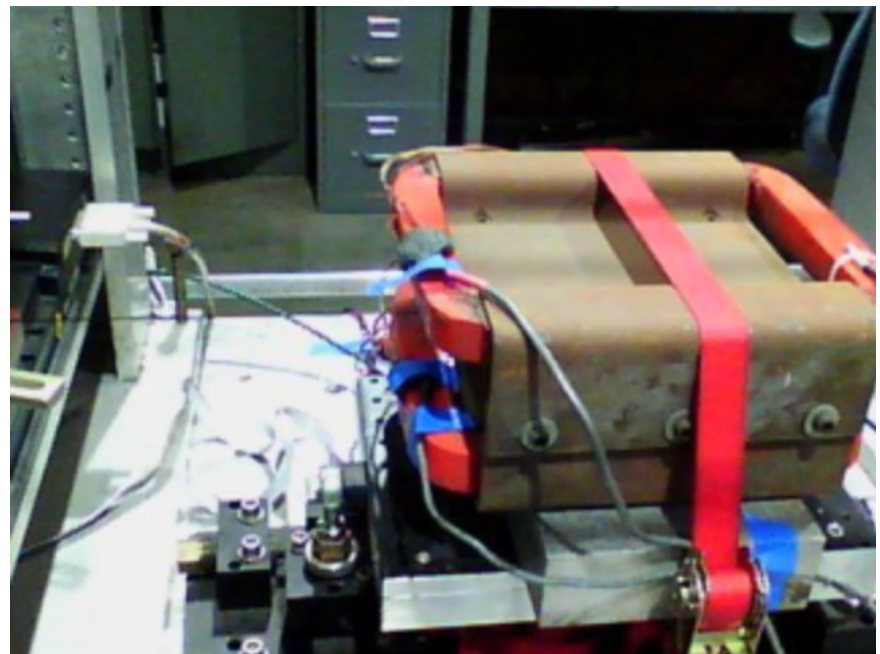

FLIR0027.jpg

FLIR C3

720149250