


# SXU\_Final\_Results\_Z\_Scans

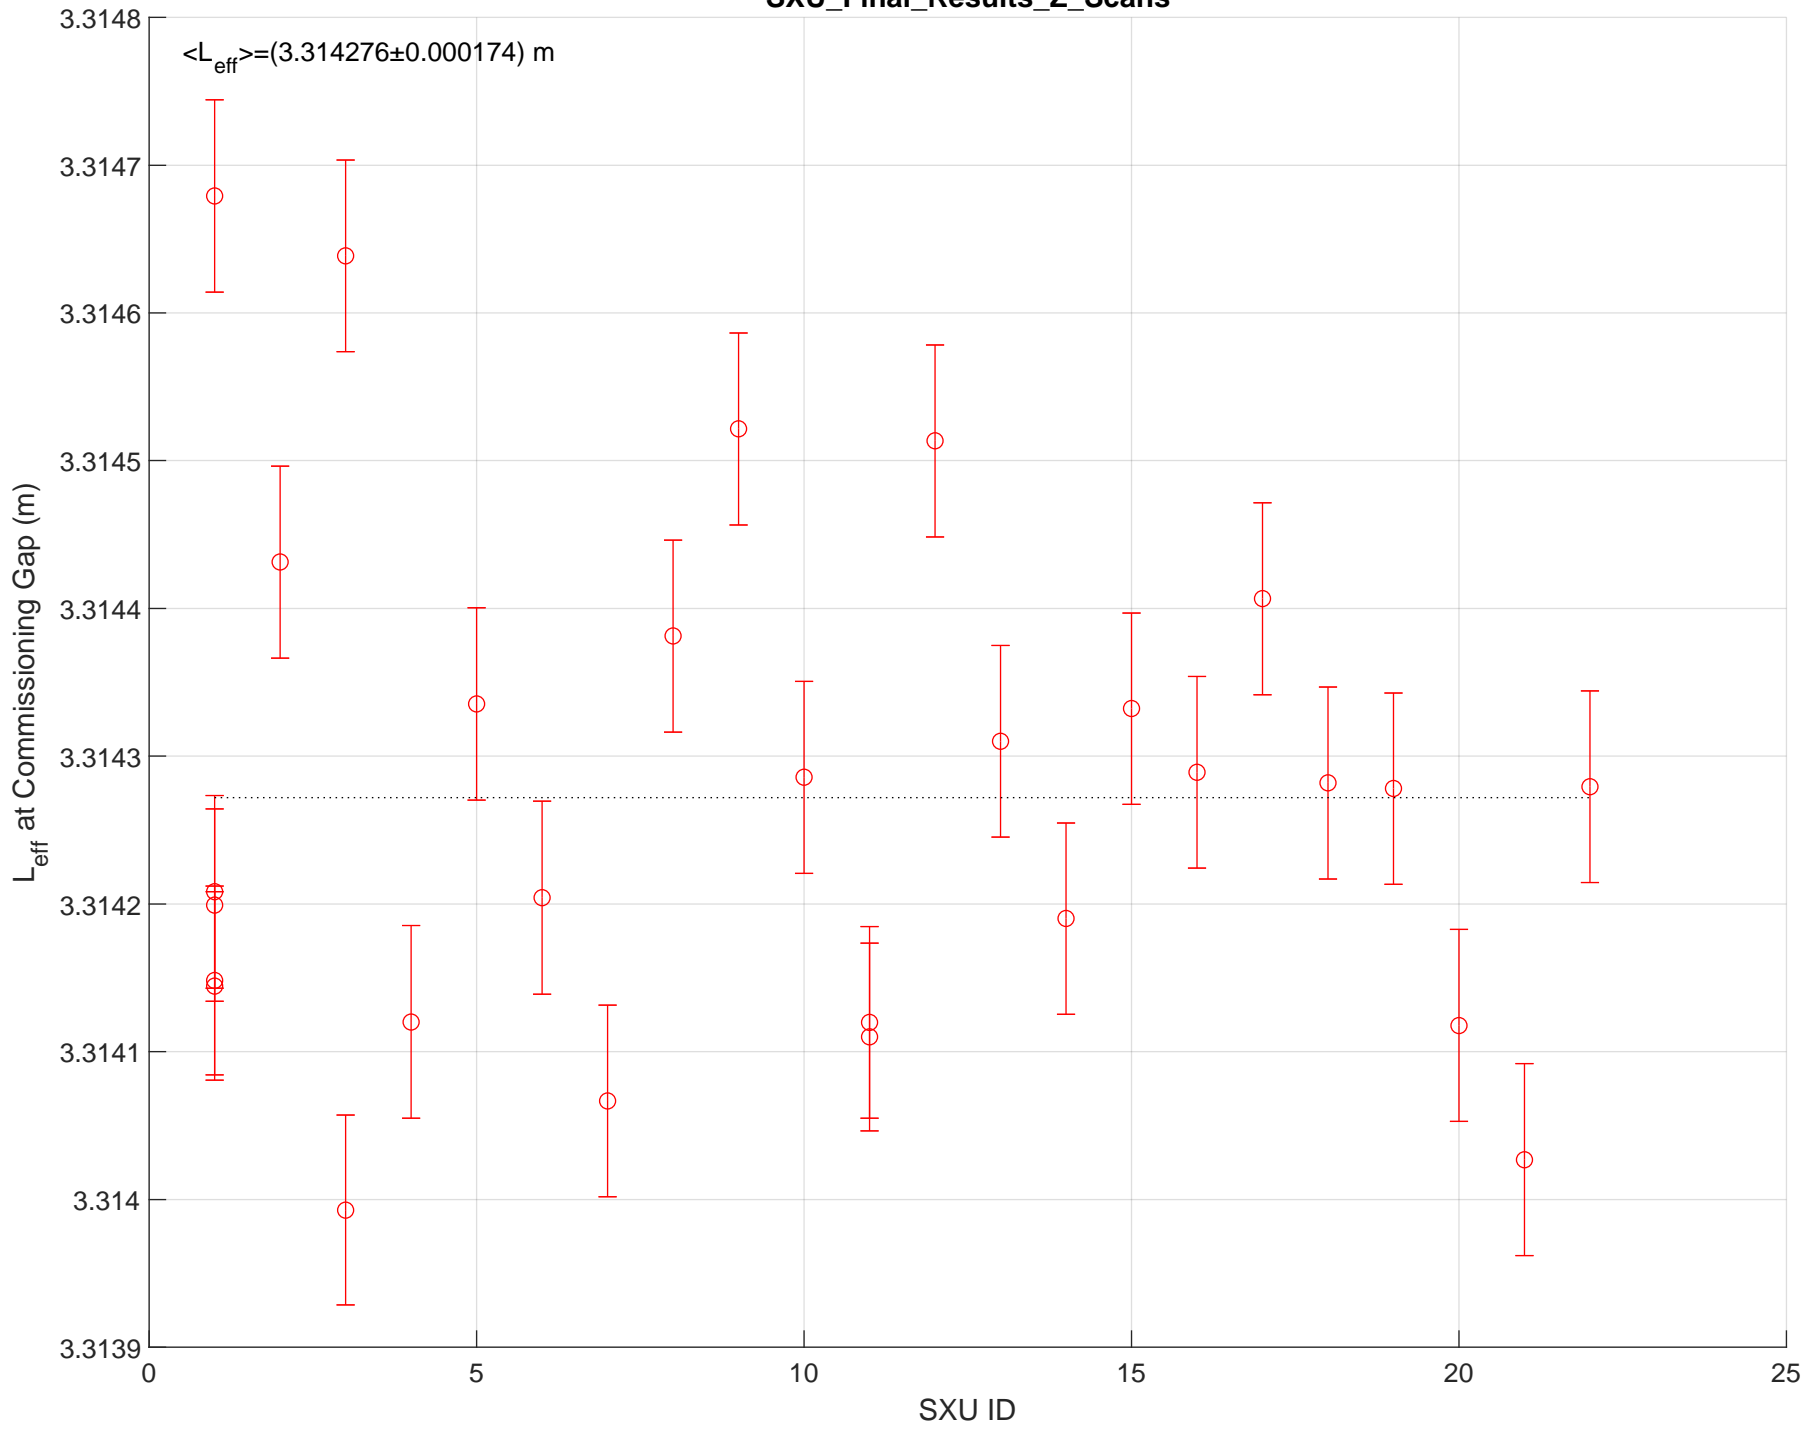

<Commissioning Gap>=(10.394±0.026) mm