

Measurements

Bx1	Max	60.9 °C
	Min	27.0 °C
	Average	54.2 °C
Bx2	Max	58.0 °C
	Min	27.8 °C
	Average	52.0 °C
Bx3	Max	56.6 °C
	Min	40.0 °C
	Average	44.8 °C
Bx4	Max	34.5 °C
	Min	28.2 °C
	Average	30.2 °C
Bx5	Max	54.8 °C
	Min	30.4 °C
	Average	45.8 °C
Sp1		57.1 °C

Parameters

Emissivity	0.95
Refl. temp.	20 °C

4/19/2010 3:16:37 PM




FLIR0085.jpg

FLIR C3

720149250

4/19/2010 3:16:37 PM

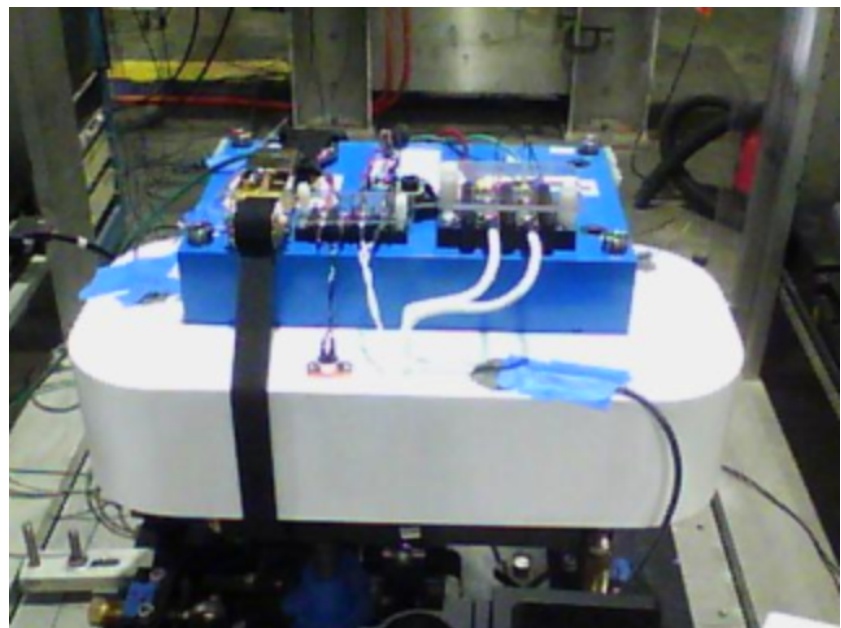

FLIR0085.jpg

FLIR C3

720149250

Measurements

Bx1	Max	54.3 °C
	Min	29.2 °C
	Average	45.2 °C
Sp1		55.5 °C

Parameters

Emissivity	0.95
Refl. temp.	20 °C

4/19/2010 3:17:00 PM



FLIR0086.jpg

FLIR C3

720149250

4/19/2010 3:17:00 PM



FLIR0086.jpg

FLIR C3

720149250


Measurements

Bx1	Max	61.9 °C
	Min	31.1 °C
	Average	54.4 °C
Bx2	Max	38.3 °C
	Min	34.4 °C
	Average	36.3 °C
Sp1		61.2 °C
Li1	Max	43.7 °C
	Min	35.2 °C
	Average	40.5 °C

Parameters

Emissivity	0.95
Refl. temp.	20 °C

4/19/2010 3:17:29 PM

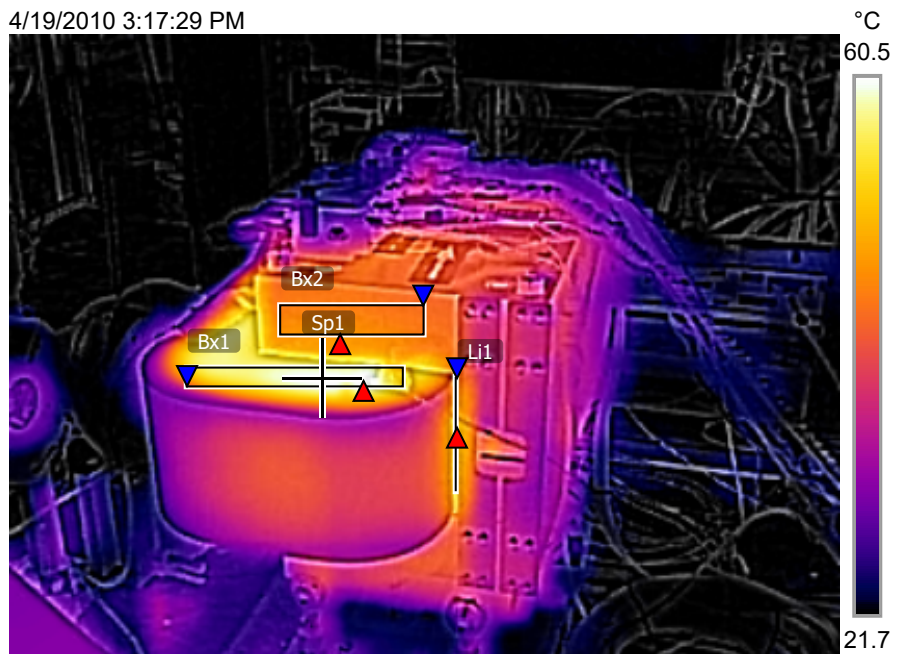


FLIR0087.jpg

FLIR C3

720149250

4/19/2010 3:17:29 PM

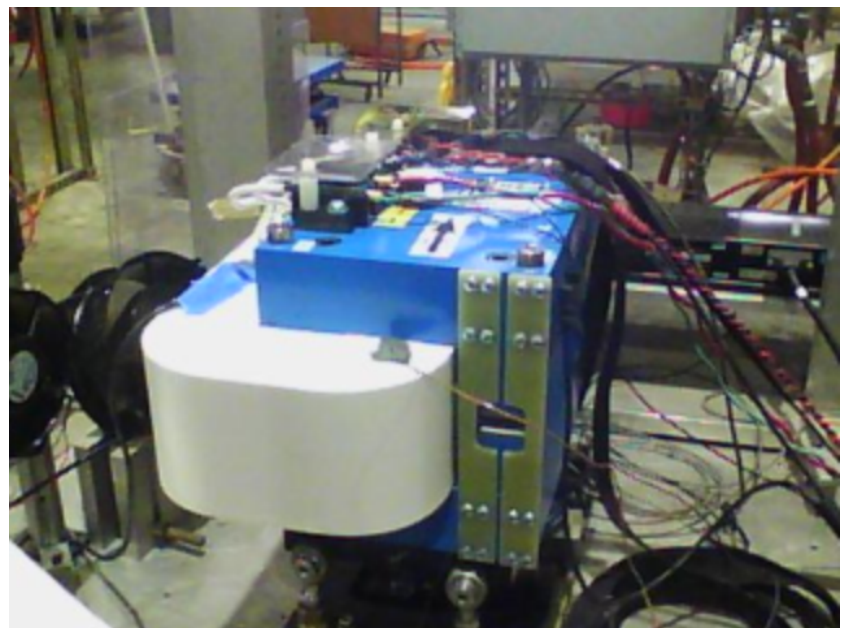

FLIR0087.jpg

FLIR C3

720149250